

THE PORT AUTHORITY
OF NY & NJ



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

**Joseph R. Loring
& Associates, Inc.**
consulting engineers

One Pennsylvania Plaza
New York, New York 10004-4045
Tel: (212) 512-7400, Fax: (212) 512-7362

THE OFFICE OF
**DAVID
ELLIOT
LEBOWITZ**
P.E.

**LESLIE E. ROBERTSON
ASSOCIATES, R.L.P.**
CONSULTING ENGINEERS
30 EAST 45TH STREET
NEW YORK, NY 10017-1005
TEL: (212) 681-1000 FAX: (212) 681-1005

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
COPY OF ONE OF THE CONTRACT DRAWINGS COM-
PLETELY A PART OF CONTRACT NO. WTC-945-071
FOR THE 5 WTC STANDBY GENERATOR BULKHEAD
HVAC PLAN AS EXECUTED BY

11/6/98 *William A. Aslan*
4/10/98 *P.L. Loring*
ENGINEER OF DESIGN

| No. | Date | Revision | Approved |
|---|----------|---------------------------------------|----------|
| 1 | 12/12/97 | GENERATOR BULKHEAD CLASSIFICATIONS | |
| 2 | 11/17/97 | ISSUED FOR BID | |
| Engineering Department Design Division | | | |


The
World
Trade
Center

STANDBY POWER
5 WORLD TRADE CENTER

MECHANICAL
5 WTC STANDBY
GENERATOR BULKHEAD
HVAC PLAN

This drawing is subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

| | | |
|-----------------|----------------|----------|
| J.D. | M.A.R. | |
| Designed by | Drawn by | Check by |
| Date | Scale | |
| 11/17/97 | AS NOTED | |
| Contract Number | Drawing Number | |
| WTC-945.071 | M2-03 | |

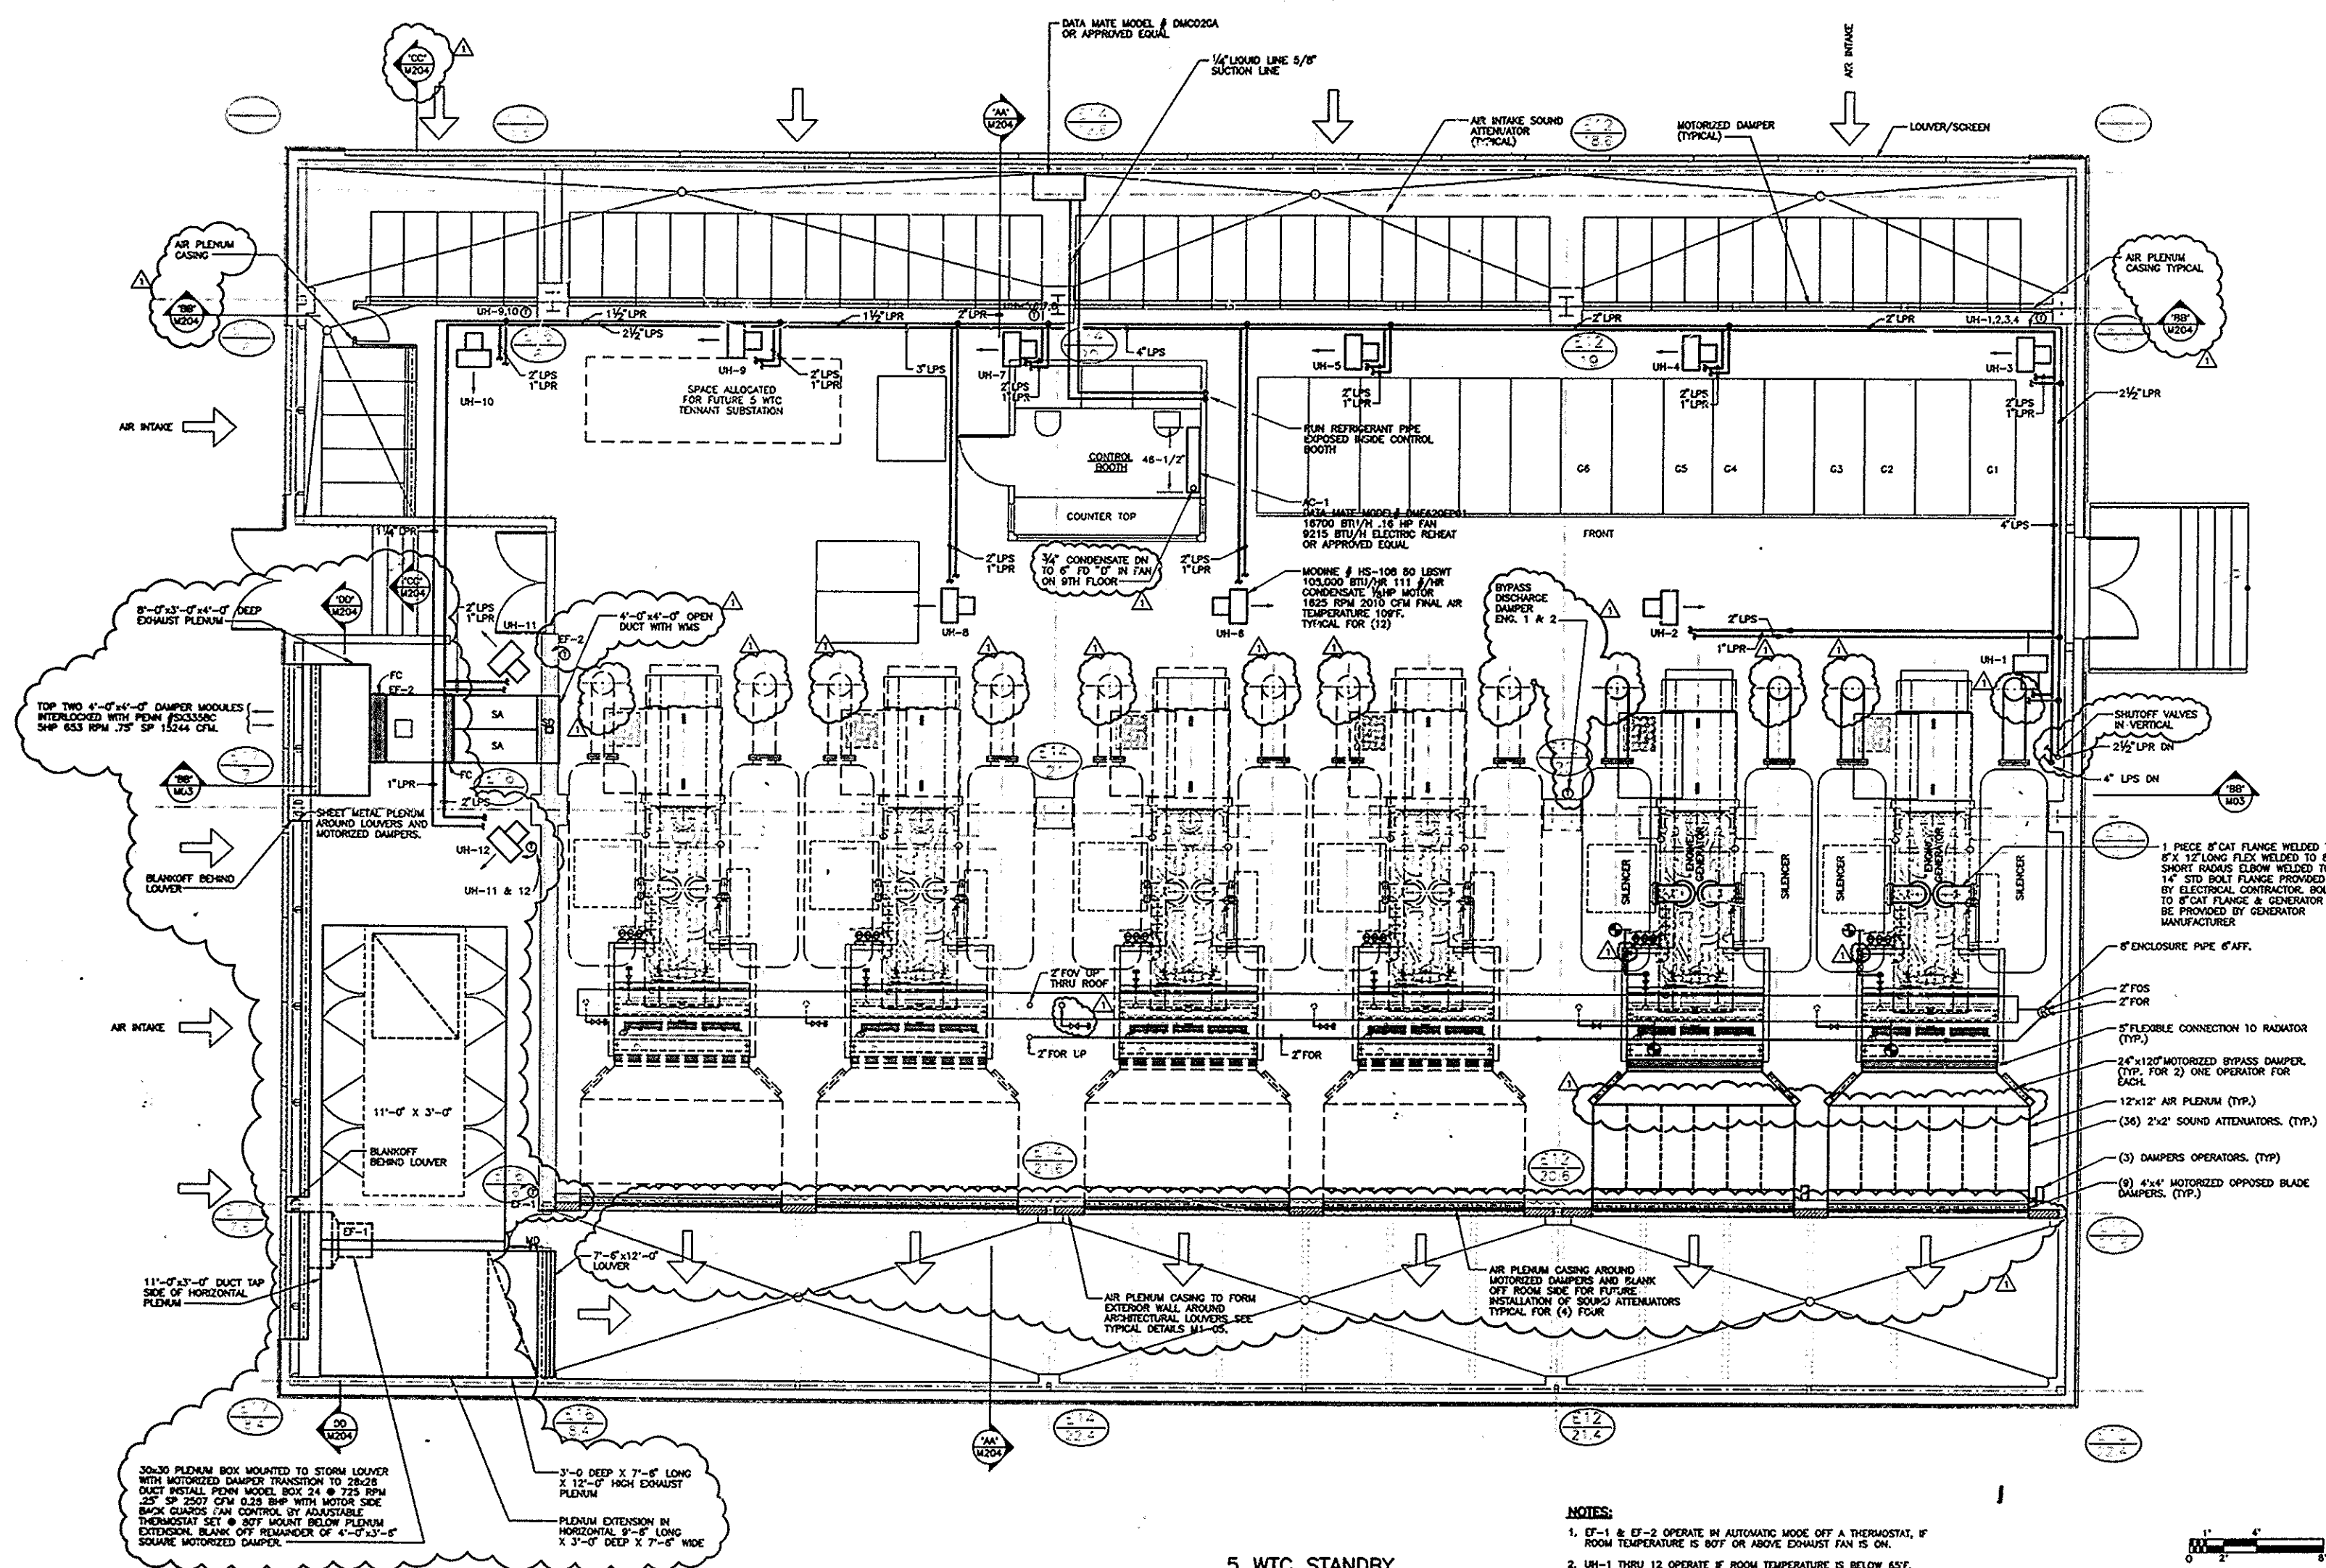

**5 WTC STANDBY
GENERATOR ROOM HVAC PLAN**

NOTES:

- EF-1 & EF-2 OPERATE IN AUTOMATIC MODE OFF A THERMOSTAT, IF ROOM TEMPERATURE IS 80°F OR ABOVE EXHAUST FAN IS ON.
- UH-1 THRU 12 OPERATE IF ROOM TEMPERATURE IS BELOW 65°F.
- AC-1 TO OPERATE OFF INTERNAL THERMOSTAT.
- SILENCER FURNISHED BY ELECTRICAL, INSTALLED UNDER MECHANICAL WORK.

